

TEST REPORT

No. : GZMR250200377204

Date : Mar 03, 2025

Page: 1 of 4



CUSTOMER NAME: NANTONG MACHS COMPOSITE MATERIAL CO.LTD
ADDRESS: NO.288 HUANGHAI ROAD,NANTONG,JIANGSU,China

Sample Name : FRP GRATING

Product specification : 19×19×25mm

Others : Sample4

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

SGS Ref. No. : SUZIN2412003486PL04

Date of Receipt : Feb 18, 2025

Testing Start Date : Feb 18, 2025

Testing End Date : Mar 03, 2025

Test result(s) : For further details, please refer to the following page(s)
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

Signed for
SGS-CSTC Standards Technical
Services Co., Ltd. Guangzhou Branch

Cathy Peng
Authorized signatory



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

□ No.191, Kaifu Road, Science City Economic & Technology Development Area, Guangzhou, Guangdong, China □ Room 101, Building 3, No.1501, Kaichuang Avenue, Huangpu District, Guangzhou, China t(86-20) 82155555 www.sgsgroup.com.cn
中国·广东·广州高新技术产业开发区科学城珠路198号 中国·广东·广州市黄埔区开创大道1501号3栋101房 t(86-20) 82155555 sgs.china@sgs.com

TEST REPORT

No. : GZMR250200377204

Date : Mar 03, 2025


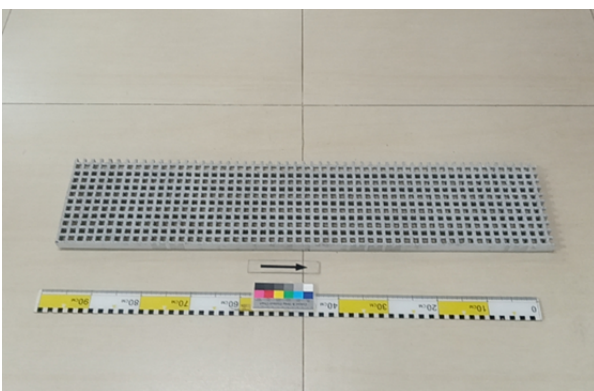
Page: 2 of 4

Summary of Results:

No.	Test Item	Test Method	Result	Conclusion
1	Determination of the Burning Behavior Using a Radiant Heat Source	AS ISO 9239.1-2003(2016)	See result	Pass

Note: Pass : Meet the requirements;
Fail : Does not meet the requirements;
/ : Not Apply to the judgment.

Original Sample Photo:

	
Original Sample-Sample D	Original Sample-Sample D



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

□ No.158, Kaifu Road, Science City Economic & Technology Development Area, Guangzhou, Guangdong, China □ Room 101, Building 3, No.1501, Kaichuang Avenue, Huangpu District, Guangzhou, China t(86-20) 82155555 www.sgs.com.cn
中国·广东·广州高新技术产业开发区科学城科珠路198号 中国·广东·广州市黄埔区开创大道1501号3栋101房 t(86-20) 82155555 sgs.china@sgs.com

TEST REPORT

No. : GZMR250200377204

Date : Mar 03, 2025

Page: 3 of 4

Test item: Determination of the Burning Behavior Using a Radiant Heat Source

Sample Description: Finished product

Test Method: AS ISO 9239.1-2003(2016)

Test condition:

Specimen: 1050mm× 230mm × 26.5mm

Flame application time: 10min

Mounting and fixing: Calcium silicate board, with its density about 1016kg/m³, thickness about 21.4mm, is as the substrate. The specimens were fixed mechanically to the substrate.

Test result:

Specimen No.	1	2	3	Average
The flame-spread distance at 10min, mm	10	10	10	10
The flame-spread distance at 20min, mm	10	10	10	10
The flame-spread distance at 30min, mm	10	10	10	10
Heat flux at 10 min (HF-10), kW/m ²	≥11	≥11	≥11	≥11
Heat flux at 20 min (HF-20), kW/m ²	≥11	≥11	≥11	≥11
Heat flux at 30 min (HF-30), kW/m ²	≥11	≥11	≥11	≥11
Critical heat flux (CHF), kW/m ²	≥11	≥11	≥11	≥11
Integrated smoke value, %·min	95.21	92.37	91.24	92.9

Client's requirement:

- CHF Value ≥ 4.5kW/m²
- HF-30 Value I ≥ 9.5kW/m²
- Smoke Value ≤ 450%·min

Conclusion: Pass



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing /inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

□ No.158, Kaifu Road, Science City Economic & Technology Development Area, Guangzhou, Guangdong, China □ Room 101, Building 3, No.1501, Kaichuang Avenue, Huangpu District, Guangzhou, China t(86-20) 82155555 www.sgsgroup.com.cn
中国·广东·广州高新技术产业开发区科学城珠路198号 中国·广东·广州市黄埔区开创大道1501号3栋101房 t(86-20) 82155555 sgs.china@sgs.com

TEST REPORT

No. : GZMR250200377204

Date : Mar 03, 2025


Page: 4 of 4

Note:

1. Specimens that do not ignite or which spread flame less than 110 mm have a critical heat flux $\geq 11\text{kW/m}^2$.
2. Observations of the burning characteristics: Charring.
3. The non granular surface was faced to the flame.

Statement: The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

Test Photo:

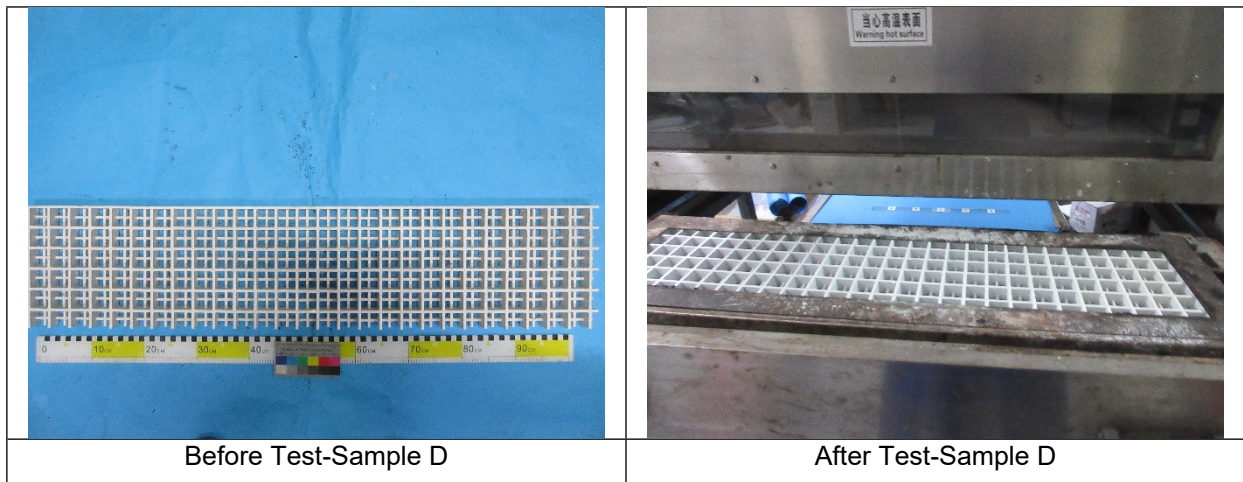

Equipment Information:

Equipment	Model	Equipment No.	Calibration date	Next Calibration date
Flooring Radiant Panel Tester	FPR	GZMR-PL-E227	2024-04-15	2025-04-14

***** End of report*****



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <https://www.sgs.com/en/Terms-and-Conditions>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

☐ No.158, Kaifu Road, Science City Economic & Technology Development Area, Guangzhou, Guangdong, China
 ☐ Room 101, Building 3, No.1501, Kaichuang Avenue, Huangpu District, Guangzhou, China
 t(86-20) 82155555
www.sgs.com.cn
 中国·广东·广州高新技术产业开发区科学城科珠路198号
 中国·广东·广州市黄埔区开创大道1501号3栋101房
 t(86-20) 82155555
sgs.china@sgs.com